


Depuratore Passiria Kläranlage Passeier



AMBIENTE.UMWELT
ACQUA.WASSER
RETE.NETZ
ANALISI.ANALYSEN

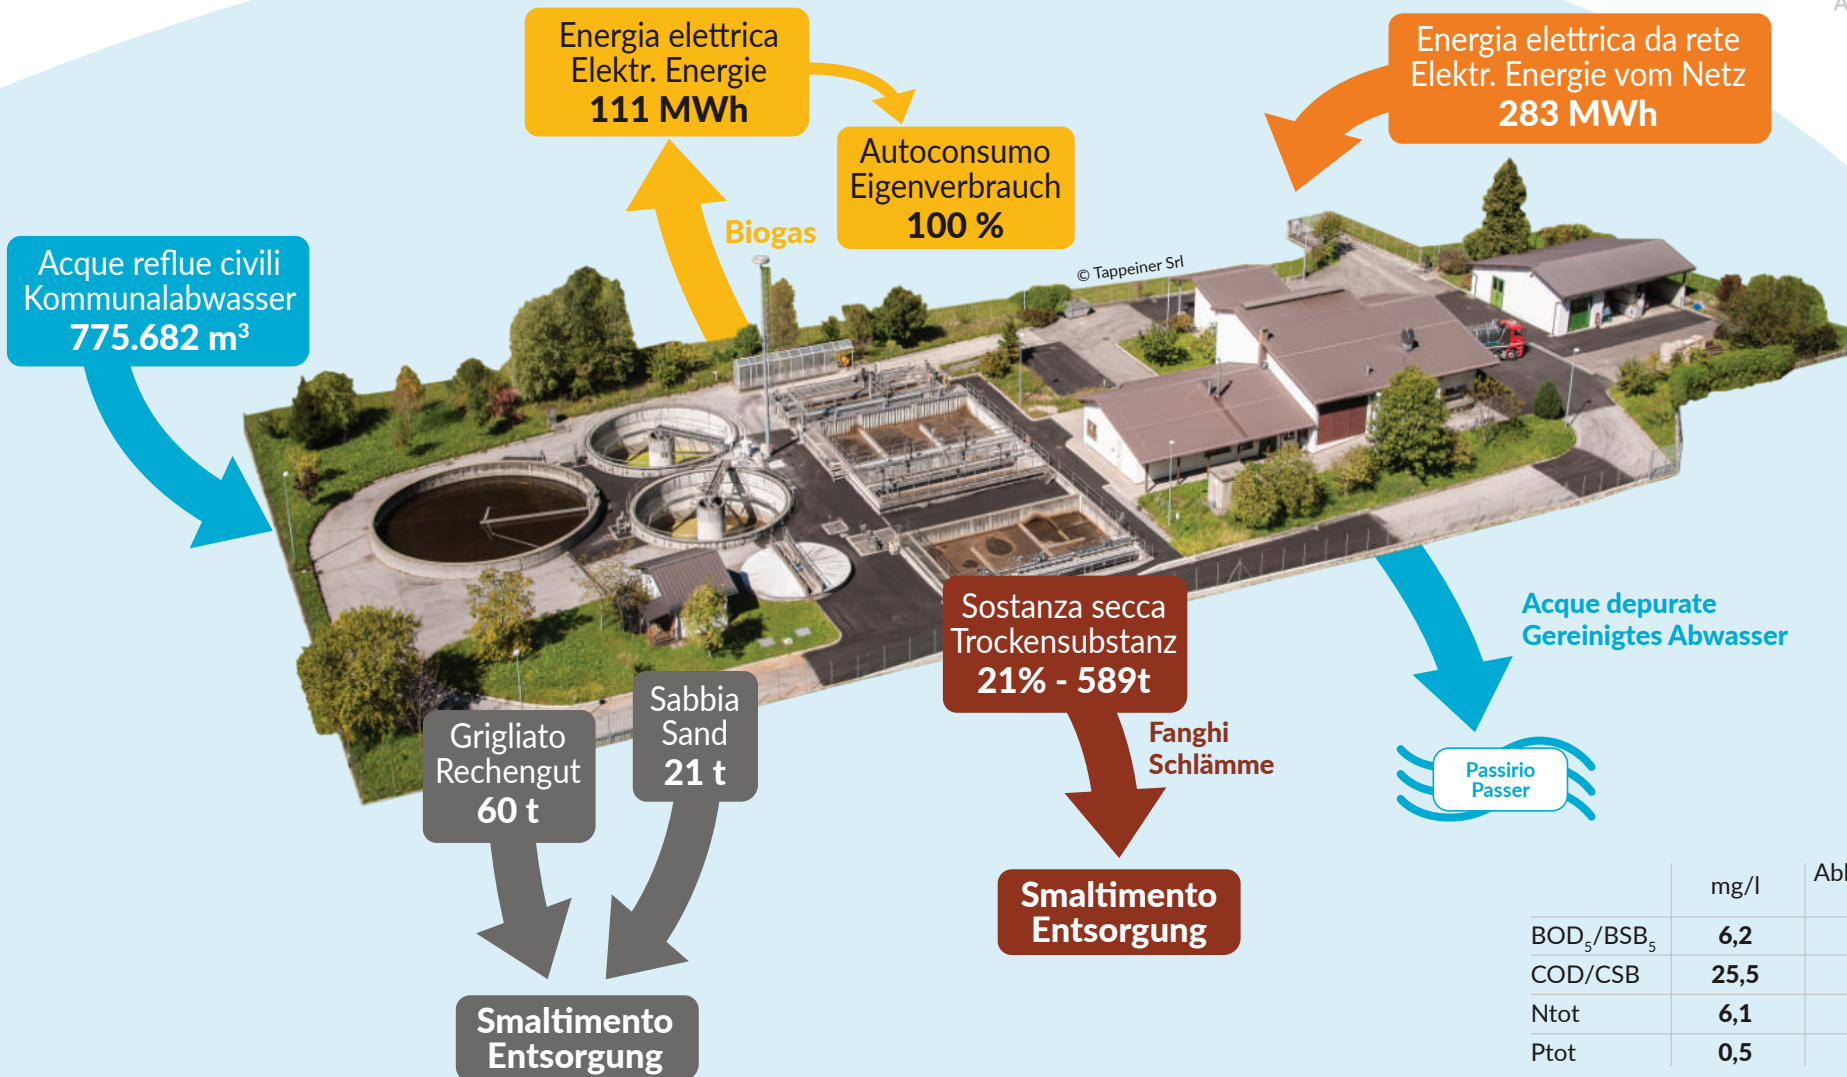

	mg/l	Abbattimento Abbau
BOD ₅ /BSB ₅	6,2	99 %
COD/CSB	25,5	96 %
N _{tot}	6,1	88 %
P _{tot}	0,5	93 %